



**ISOMETRIC VIEW**

**NOTES:**

1. METER SHALL BE PLACED IN BASEMENT, PROTECTED FROM FREEZING AND DAMAGE.
2. INSIDE METER SETTING IS PERMITTED ONLY IF TOTAL LENGTH OF SERVICE PIPE DOES NOT EXCEED 60 FT FROM MAIN TO METER SETTING.
3. A FLOOR DRAIN IS REQD WITHIN 10 FT OF THE METER FOR ALL NEW METER INSTALLATIONS (RECOMMENDED FOR EXISTING INSTALLATIONS).
4. NO CONNECTIONS ARE PERMITTED BEFORE THE METER OUTLET VALVE EXCEPT AS SHOWN ON THIS DRAWING.
5. METERS REQUIRE ELECTRONIC DIGITAL ENCODER REGISTER OR MECHANICALLY ENCODED REGISTER WITH ITRON REMOTE ERT AND 10 FT OF SIGNAL CABLE. ERT IS NORMALLY LOCATED NEAR BASEMENT CEILING AT WALL FACING STREET, BUT MAY BE MOUNTED ON OUTSIDE OF BUILDING.
6. IF METER IS BOXED IN OR PLACED BEHIND A WALL, PROVIDE ACCESS OPENING 36" WIDE FROM ABOVE OUTLET VALVE TO FLOOR.

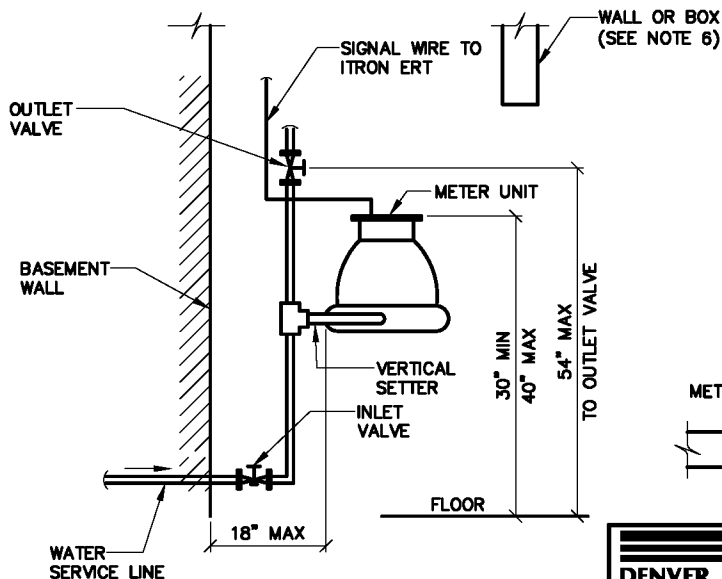

**ELEVATION**

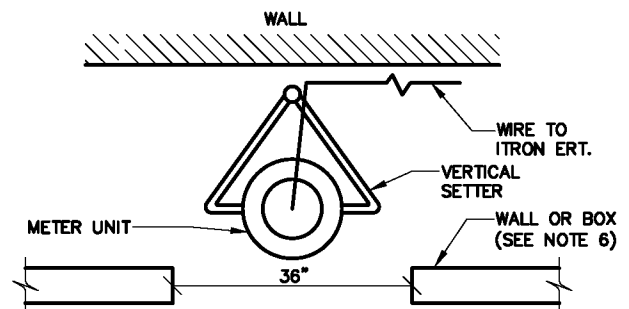

**PLAN**

**DENVER WATER**

1800 West 12th Avenue • Denver, Colorado 80204  
Phone (303) 628-6000 • Telecopier No. (303) 628-6851

**TYPICAL INSIDE SETTING FOR  
3/4" AND 1" METER WITH AMR**

Scale: <u>NONE</u>	Date: <u>AUGUST 1995</u>
Drawn: <u>C.B.B.</u>	Tr: <u>    </u> Ck: <u>    </u>
Approved: <u>[Signature]</u>	Dr. <u>127</u> No. <u>35</u>